


REFER TO STANDARD MANHOLE DETAIL.

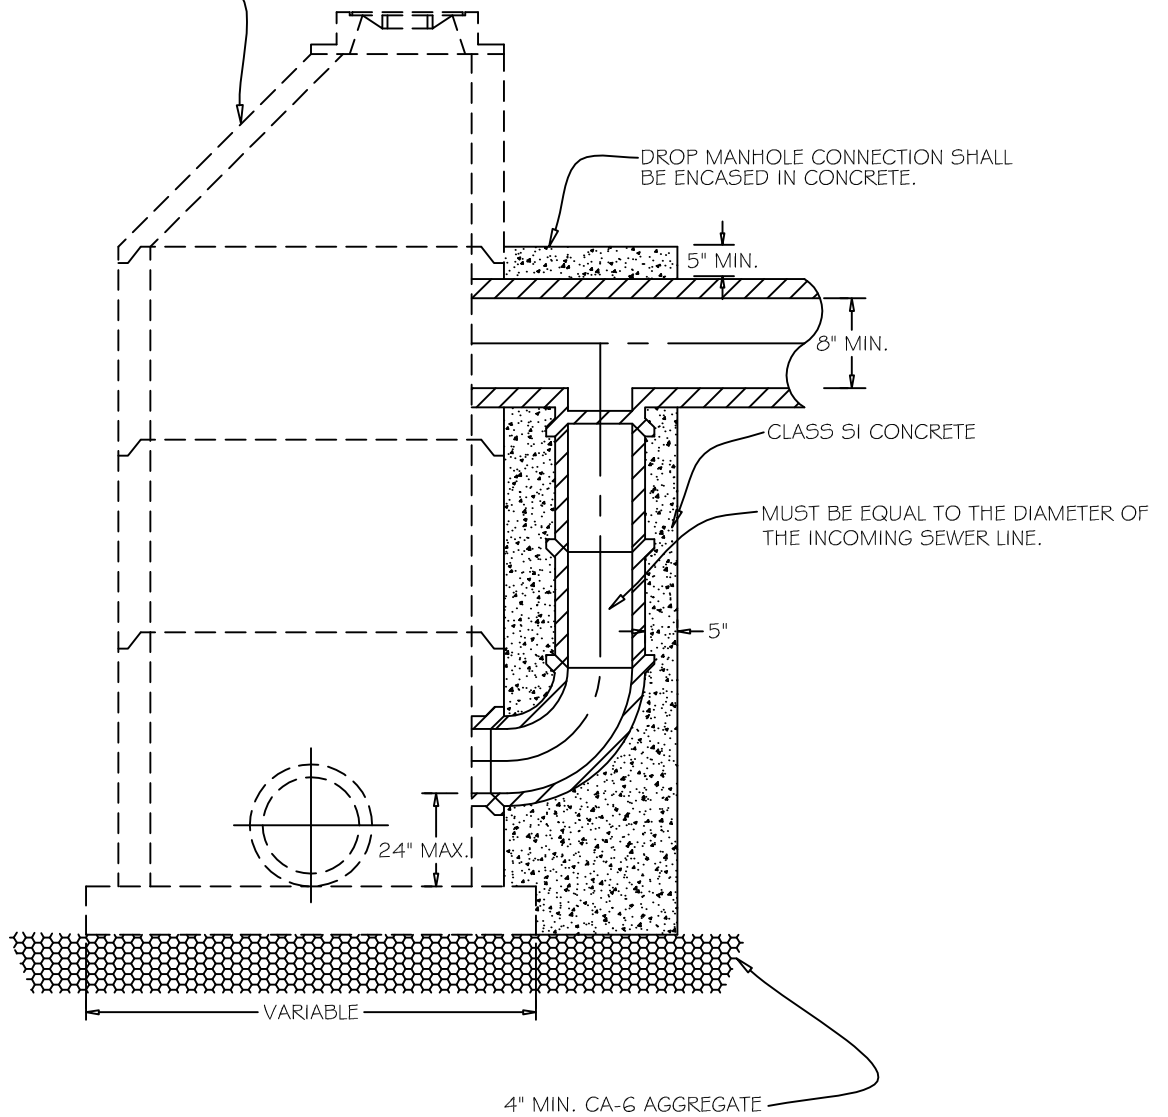

GENERAL NOTES:

1. DROP CONNECTION SHALL BE REQUIRED WHEN THE DIFFERENCE IN ELEVATION OF INVERTS OF TWO (2) INTERSECTING CONDUITS IS GREATER THAN 24 INCHES.
2. DROP CONNECTION SHALL BE ENCASED IN CONCRETE.

NOT TO SCALE

| | |
|--------------|----------------|
| REV: | DATE: |
| REV: RMS | DATE: JUL 2004 |
| DRAWN BY: VV | DATE: JAN 2003 |

DROP CONNECTION TO
SANITARY MANHOLE

VILLAGE OF VILLA PARK
SANITARY - 04