



Village of Villa Park

Permitting Division

11 W. Home Avenue Villa Park, IL. 60181

P: 630-834-8505 Fax: 630-834-8509

Email: permits@invillapark.com

PUBLIC SIDEWALKS, DRIVEWAY APPROACHES & CURBS

PERMIT APPLICATION

The Village of Villa Park requires a permit prior to beginning any construction.

To obtain a permit, the following is required:

- Completed Highway Permit Application
- Contractors must register with the Permitting Department at Public Works and post a certificate of insurance with the Village of Villa Park as the certificate holder and additional insured
- If approach is brick a covenant regarding driveway and apron responsibility is to be filled out

Call JULIE (Joint Utility Locating Information for Excavators) at 1-800-892-0123 allowing 48 hours to locate utilities.

INSPECTIONS REQUIRED

One inspection prior to placement of concrete or asphalt

Final Inspection when work is completed prior to release of bond

GENERAL REQUIREMENTS

All concrete shall be at least a 6-bag mix. Slump shall be no greater than 4" and no less than 2".

PUBLIC WALK REQUIREMENTS

All sidewalks shall meet existing widths with a minimum thickness of 4" except at any existing or proposed driveway(s) the thickness shall be 6".

Bedding shall be a minimum of 4" of CA-6/Grade 8 mechanically compacted stone.

All pavements shall be replaced within one week of their removal.

All parkways disturbed during construction shall be restored with 4" of topsoil and sod.

Recommended for commercial and industrial: 8" minimum concrete, 4" minimum mechanically compacted stone

Note: Public Works requires a cash bond to be posted prior to issuing permit.

DRIVEWAY APPROACH REQUIREMENTS

Asphalt – minimum 6" mechanically compacted stone plus 4" of Class I surface hot mix (recommend 8" compacted stone)


Concrete – minimum 4" mechanically compacted stone plus 6" P.C.C.

Recommended for commercial and industrial: 4" minimum mechanically compacted stone plus 8" P.C.C. – 8" minimum mechanically compacted stone plus 4" asphalt

CURB AND GUTTER REQUIREMENTS


If approach is to be widened, 25' maximum at curb, curb and gutter shall be removed and replaced with depressed curb and gutter to a minimum depth of 10" of concrete with 4" of mechanically compacted stone building.

B-6.12

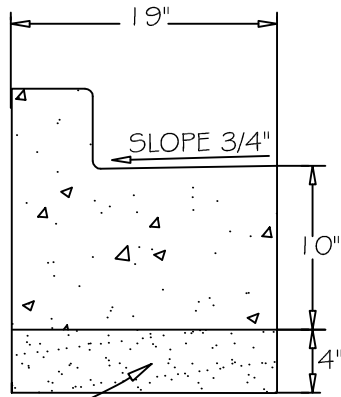


4" MIN. BEDDING (CA-6 GRADATION)

M-4.12

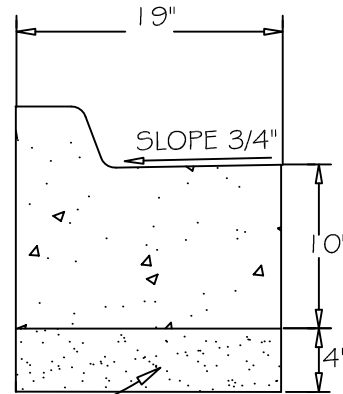

4" MIN. BEDDING (CA-6 GRADATION)

DEPRESSED

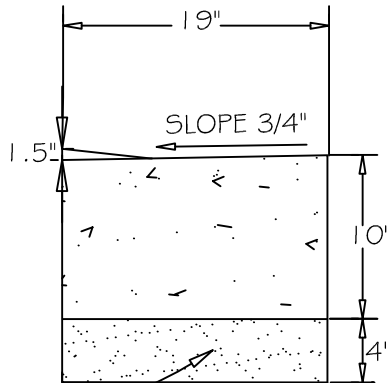

4" MIN. BEDDING (CA-6 GRADATION)

GENERAL NOTES:

1. CONTRACTION JOINTS SHALL BE PLACED BETWEEN EXPANSION JOINTS AT 15' INTERVALS.
2. EXPANSION JOINTS ARE TO BE PLACED AT 60' INTERVALS. 2-#6 X 18" REBARSTO BE PLACED AT ALL EXPANSION JOINTS.


NOT TO SCALE

REV:	DATE:
REV: RMS	DATE: JUL 2004
DRAWN BY: VV	DATE: JAN 2003

COMBINATION CONCRETE
CURB AND GUTTER



VILLAGE OF VILLA PARK
ROAD - 02

PLAN


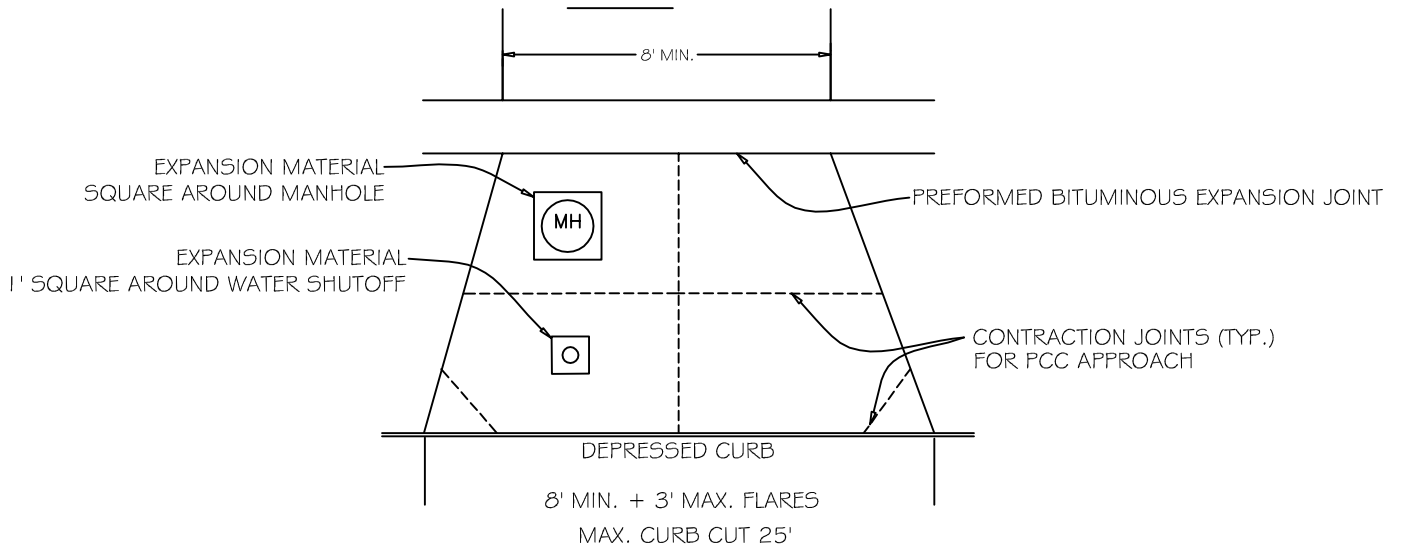


PROFILE

COMMERCIAL

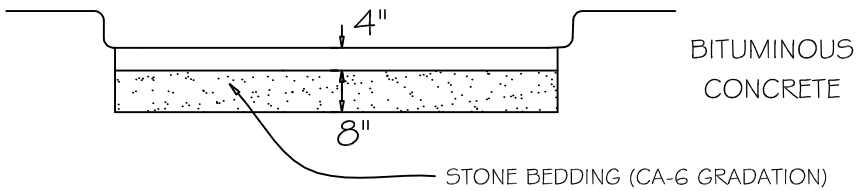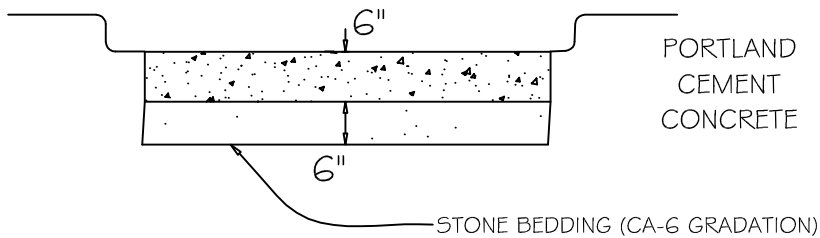

RESIDENTIAL

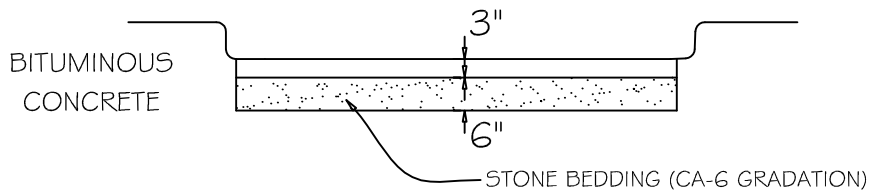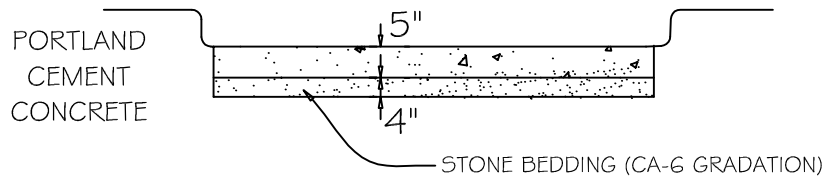

GENERAL NOTES:

1. CURBING AND PROTECTION FOR IDOT SPECS AS APPROVED BY THE VILLAGE ENGINEER
2. ALL STONE BEDDING SHALL BE MECHANICALLY COMPACTED

NOT TO SCALE

REV:	RMS	DATE: JAN 2018
REV:	RMS	DATE: JUL 2004
DRAWN BY:	VV	DATE: JAN 2003

TYPICAL DRIVEWAY APPROACH

VILLAGE OF VILLA PARK
STREET - 03